



Sloped roof

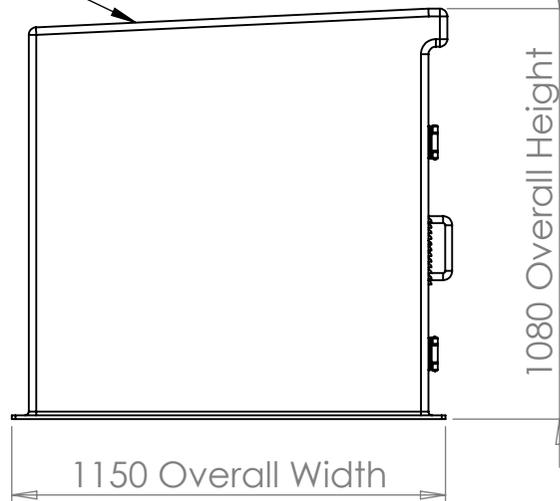

1150 Overall Width

1080 Overall Height

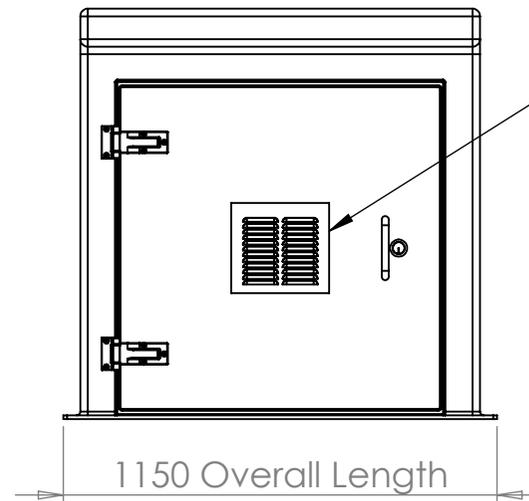

1150 Overall Length

Louvered vent

TITLE
PWH1000

DRAWN BY J. Ellison DATE 17/12/2021

Foundation Requirements:
The foundation area must be no less in length and width than the external dimensions of the enclosure. The foundation must be constructed so as to be capable of supporting the weight of the enclosure and equipment contained within it. The foundation must be continuous and be no more than ±2mm over any given metre.

DESCRIPTION:
PWH1000 c/w Louvered vent

DATE	VERSION	NOTES
17/12/2021	A	FIRST ISSUE

TANK SPECIFICATION :	
INTERNAL DIMENSIONS	1000 x 1000 x 1000mm
EXTERNAL DIMENSIONS	1150 x 1150 x 1080mm
NOM. CAPACITY	1000 Litres
DRY WEIGHT	54 KG
INSULATION THICKNESS	25mm
MATERIAL	GRP



CUSTOMER CUSTOMER


ALL DIMENSIONS +/- 5mm UNLESS OTHERWISE STATED

A4 ALL DIMENSIONS IN MM - DO NOT SCALE

SCALE: 1:20

SHEET 1 OF 2

SCALE: 1:20 SHEET 1 OF 2

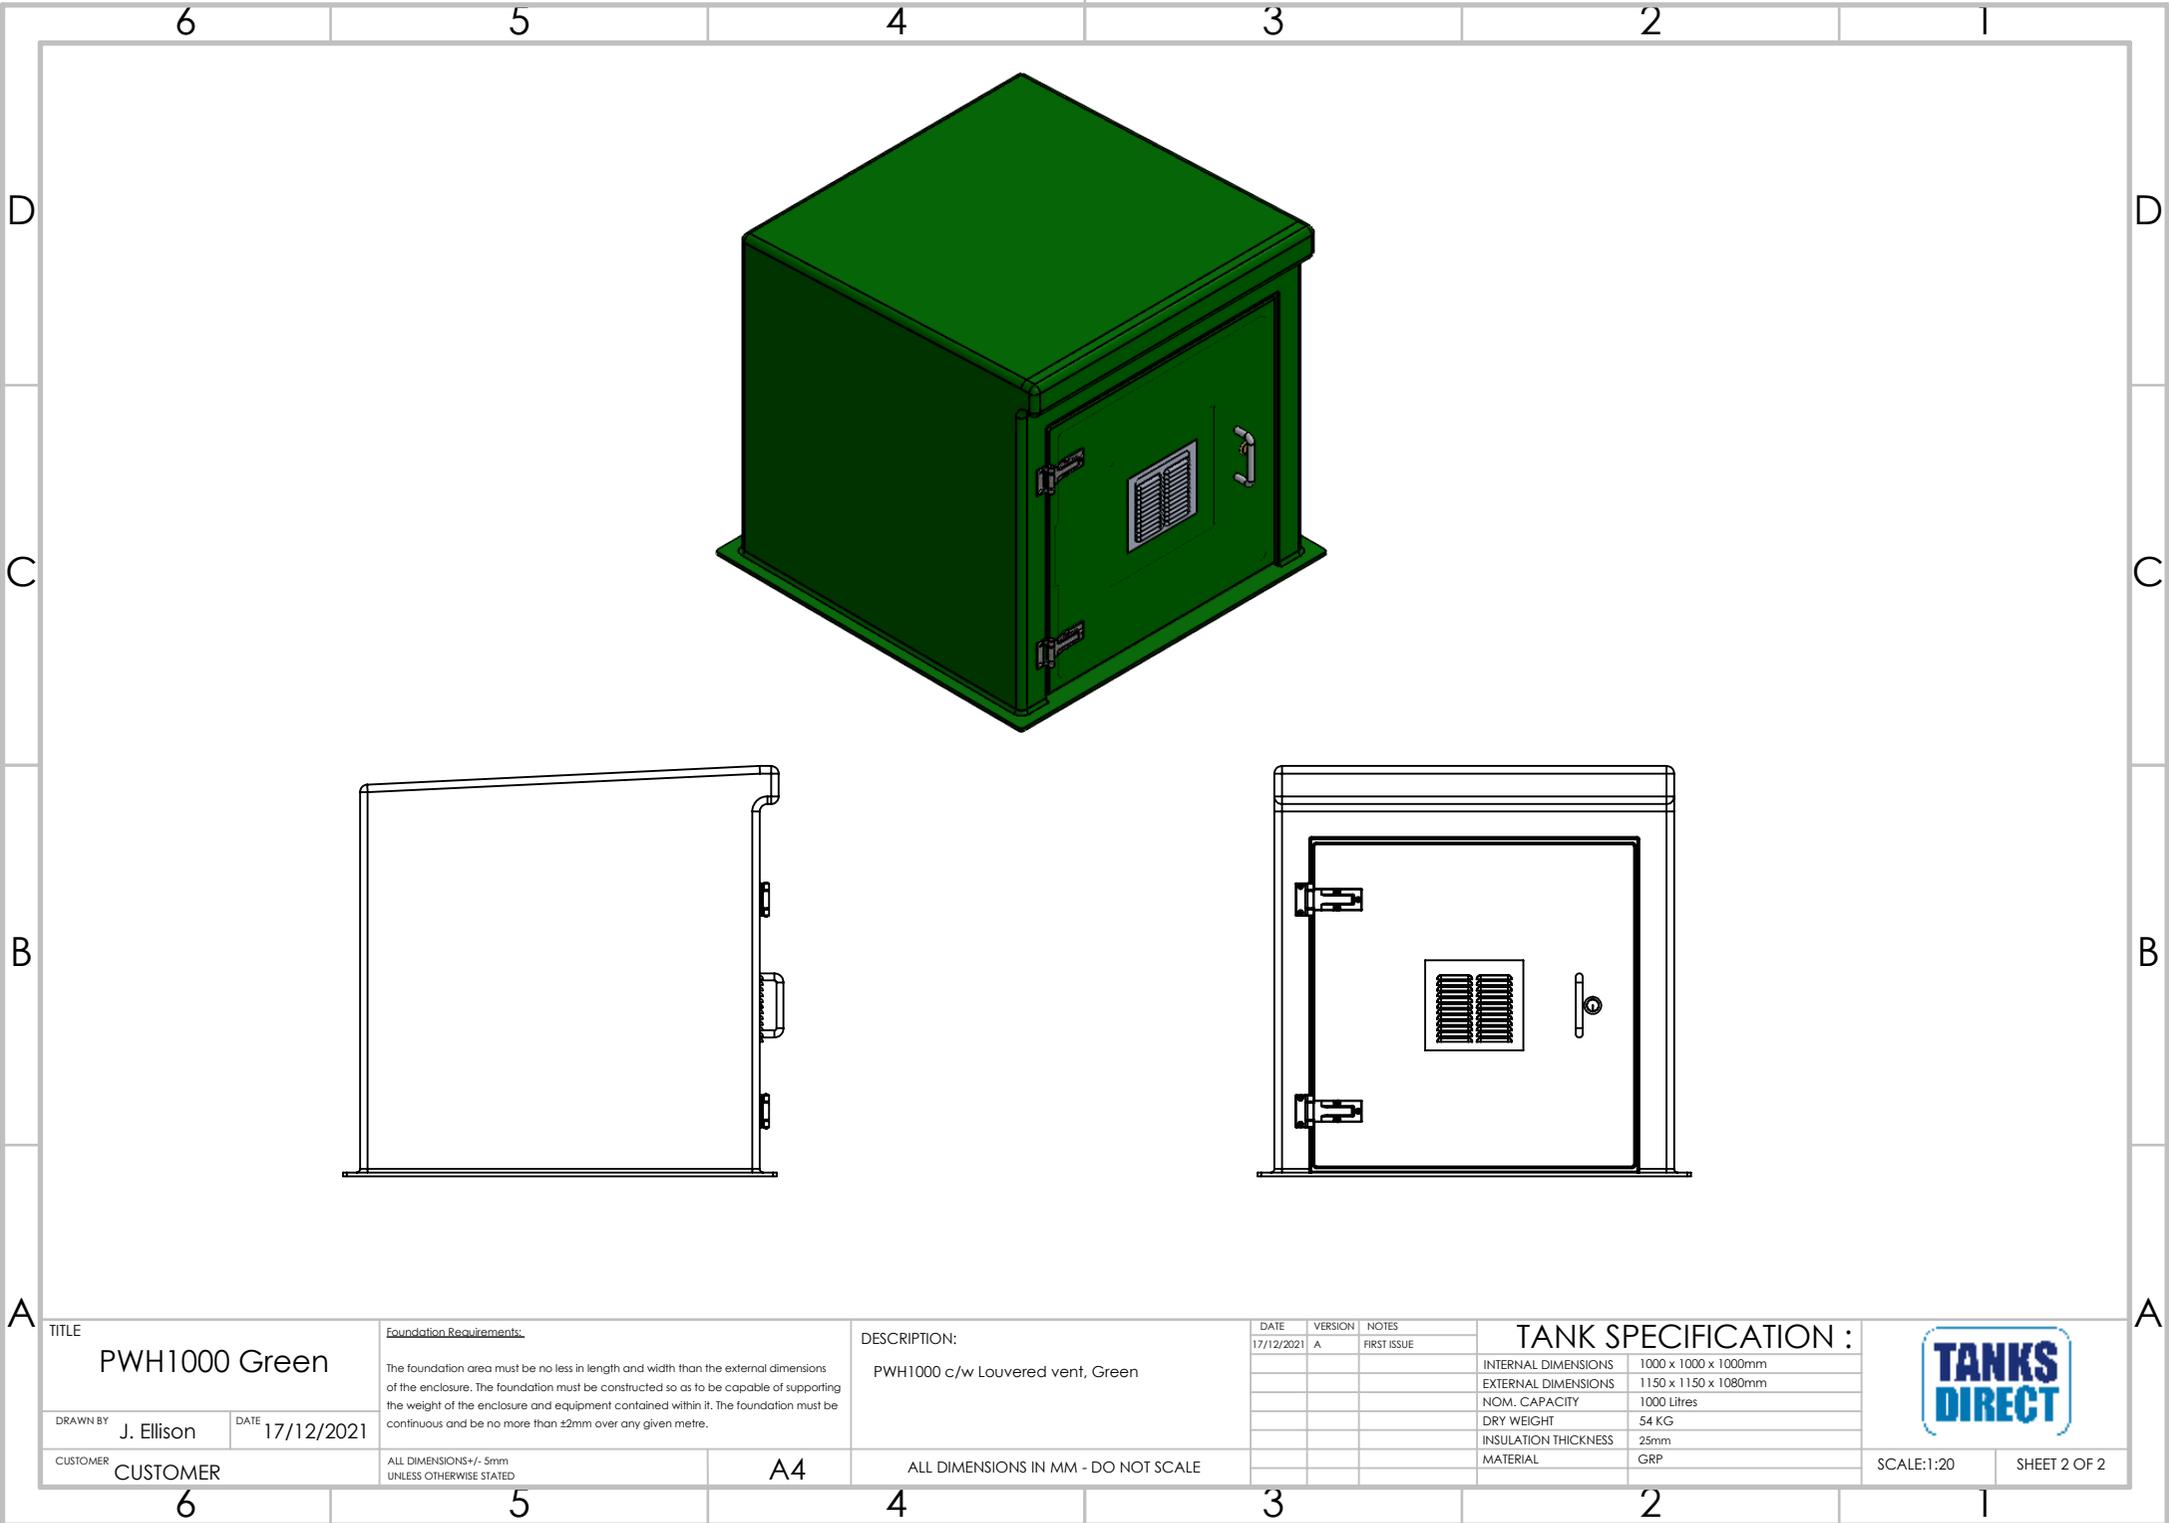

TITLE
PWH1000 Green

DRAWN BY **J. Ellison** DATE **17/12/2021**

CUSTOMER **CUSTOMER**

Foundation Requirements:
 The foundation area must be no less in length and width than the external dimensions of the enclosure. The foundation must be constructed so as to be capable of supporting the weight of the enclosure and equipment contained within it. The foundation must be continuous and be no more than ±2mm over any given metre.

ALL DIMENSIONS +/- 5mm
 UNLESS OTHERWISE STATED

DESCRIPTION:
PWH1000 c/w Louvered vent, Green

A4

ALL DIMENSIONS IN MM - DO NOT SCALE

DATE	VERSION	NOTES
17/12/2021	A	FIRST ISSUE

TANK SPECIFICATION :

INTERNAL DIMENSIONS	1000 x 1000 x 1000mm
EXTERNAL DIMENSIONS	1150 x 1150 x 1080mm
NOM. CAPACITY	1000 Litres
DRY WEIGHT	54 KG
INSULATION THICKNESS	25mm
MATERIAL	GRP



SCALE:1:20 SHEET 2 OF 2