

TITLE
PWH1818

DRAWN BY
J. Ellison

DATE
17/12/2021

CUSTOMER
CUSTOMER

Foundation Requirements:
The foundation area must be no less in length and width than the external dimensions of the enclosure. The foundation must be constructed so as to be capable of supporting the weight of the enclosure and equipment contained within it. The foundation must be continuous and be no more than ±2mm over any given metre.

ALL DIMENSIONS+/- 5mm
UNLESS OTHERWISE STATED

DESCRIPTION:
PWH1818 c/w Louvered vent

A4

ALL DIMENSIONS IN MM - DO NOT SCALE

DATE	VERSION	NOTES
17/12/2021	A	FIRST ISSUE

TANK SPECIFICATION :	
INTERNAL DIMENSIONS	1220 x 1220 x 1220mm
EXTERNAL DIMENSIONS	1370 x 1370 x 1300mm
NOM. CAPACITY	1818 Litres
DRY WEIGHT	125 KG
INSULATION THICKNESS	25mm
MATERIAL	GRP




SCALE:1:25

SHEET 1 OF 2

6 5 4 3 2 1

D
C
B
A

D
C
B
A

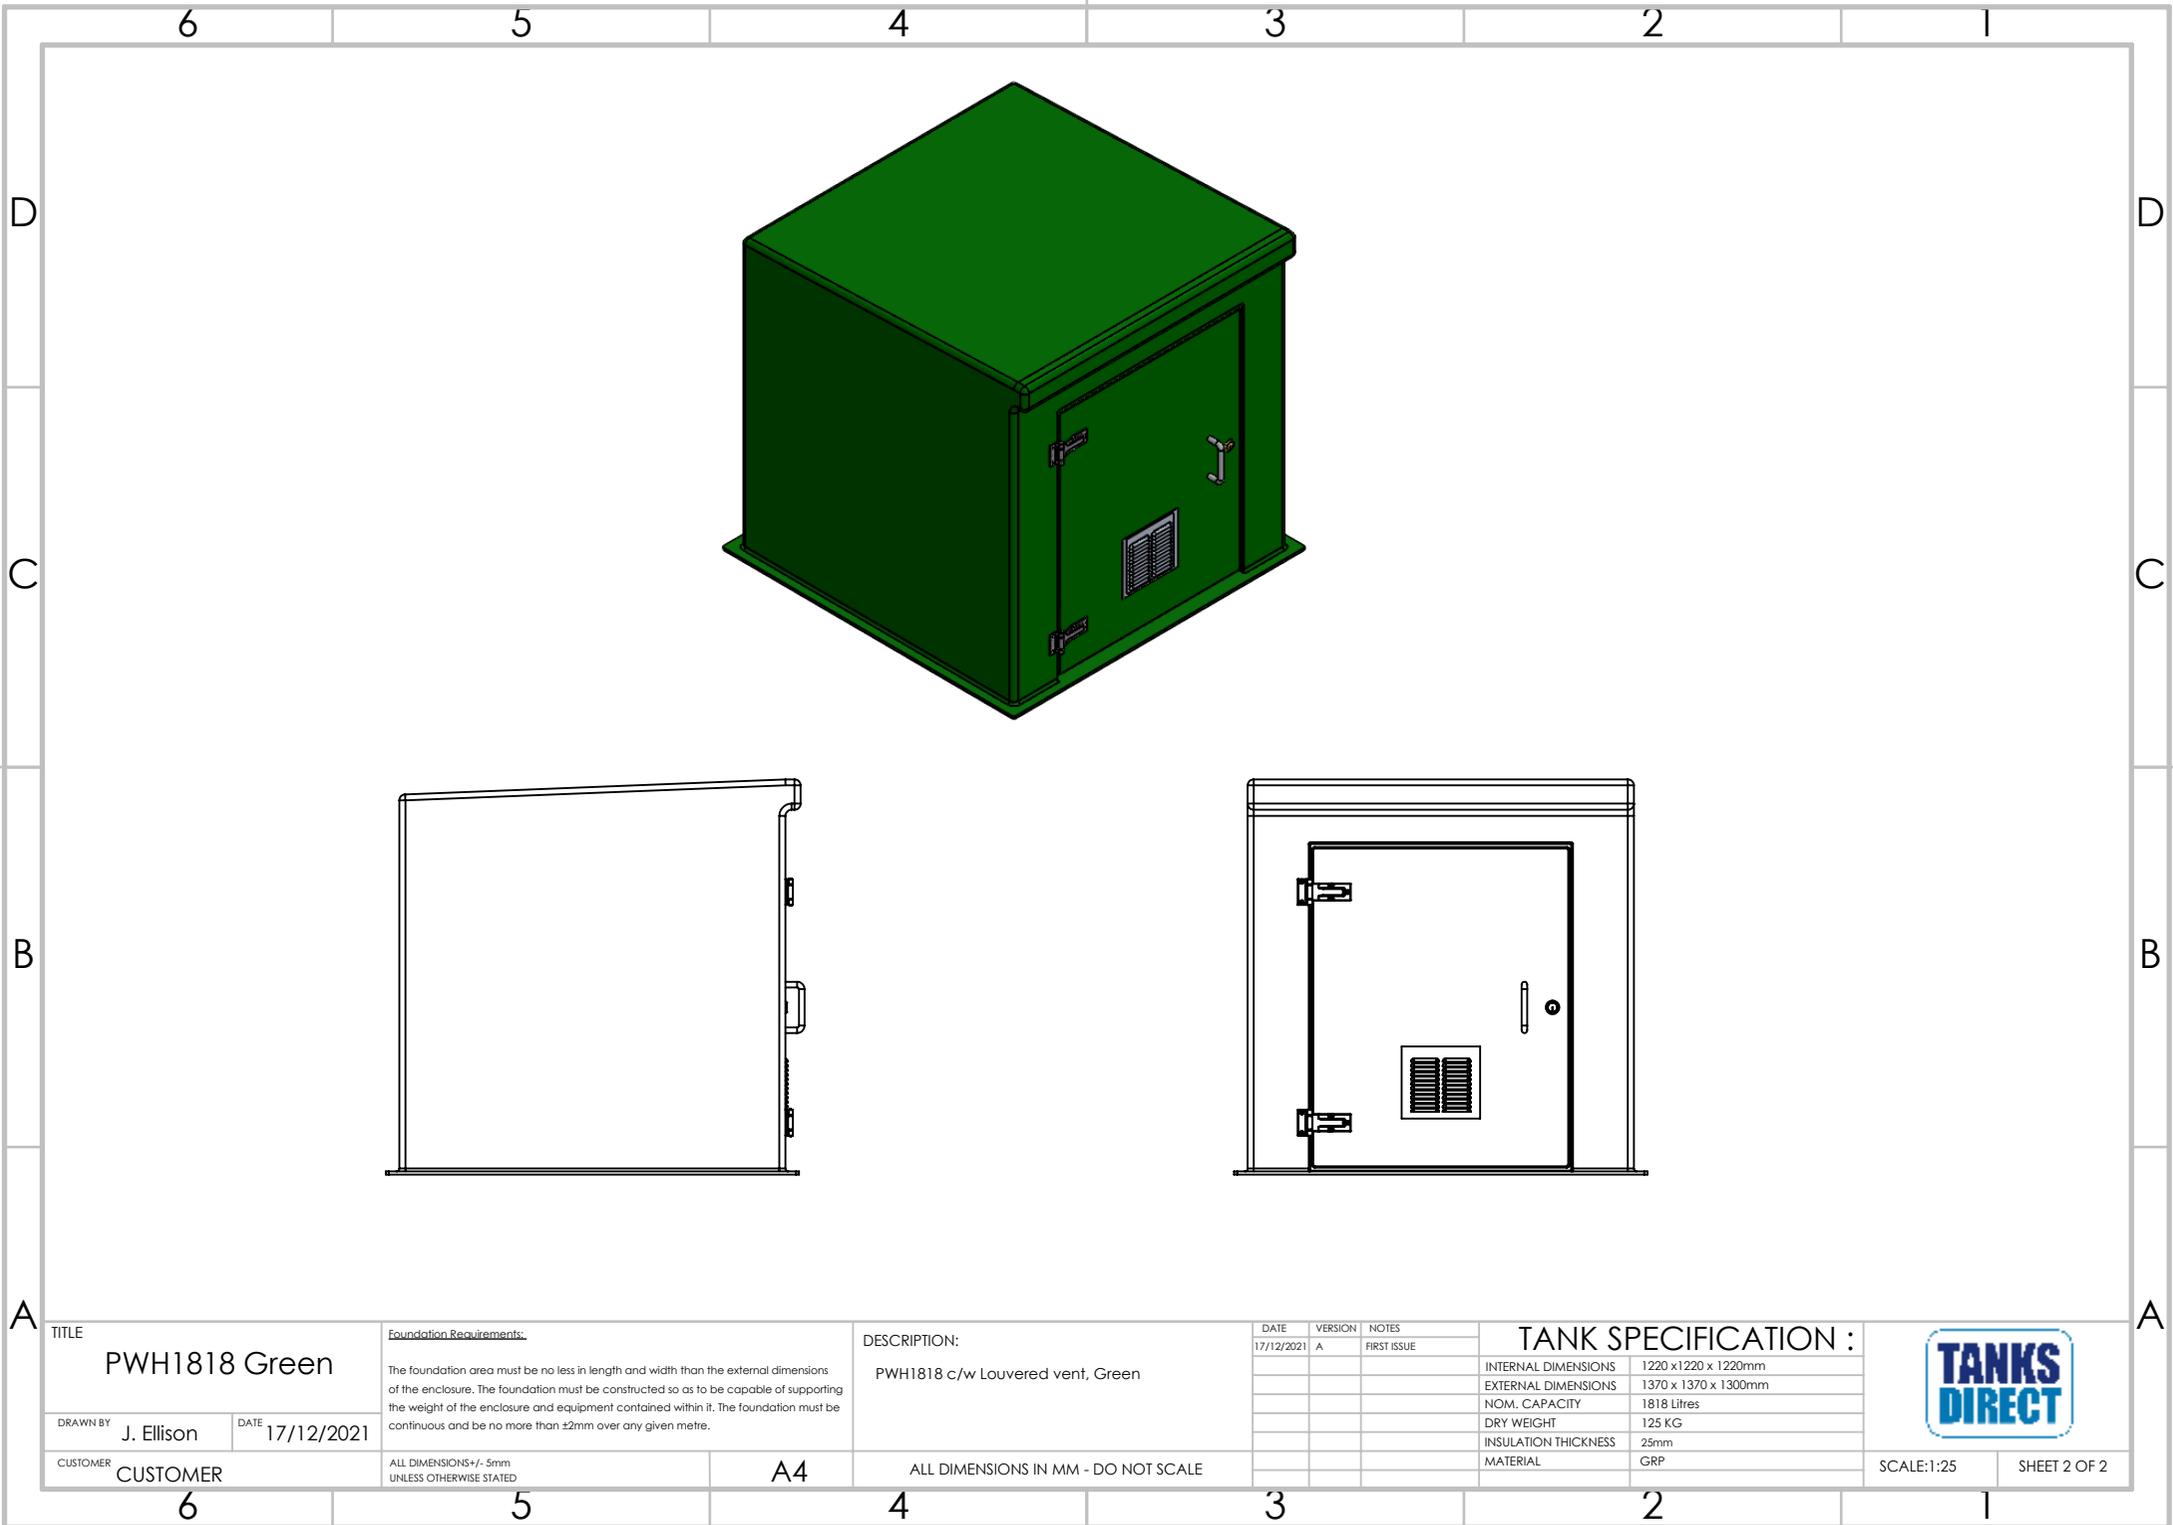

TITLE
PWH1818 Green

DRAWN BY **J. Ellison** DATE **17/12/2021**

CUSTOMER **CUSTOMER**

Foundation Requirements:
The foundation area must be no less in length and width than the external dimensions of the enclosure. The foundation must be constructed so as to be capable of supporting the weight of the enclosure and equipment contained within it. The foundation must be continuous and be no more than ±2mm over any given metre.

ALL DIMENSIONS +/- 5mm
UNLESS OTHERWISE STATED

A4

DESCRIPTION:
PWH1818 c/w Louvered vent, Green

ALL DIMENSIONS IN MM - DO NOT SCALE

DATE	VERSION	NOTES
17/12/2021	A	FIRST ISSUE

TANK SPECIFICATION :	
INTERNAL DIMENSIONS	1220 x 1220 x 1220mm
EXTERNAL DIMENSIONS	1370 x 1370 x 1300mm
NOM. CAPACITY	1818 Litres
DRY WEIGHT	125 KG
INSULATION THICKNESS	25mm
MATERIAL	GRP



SCALE:1:25 SHEET 2 OF 2