
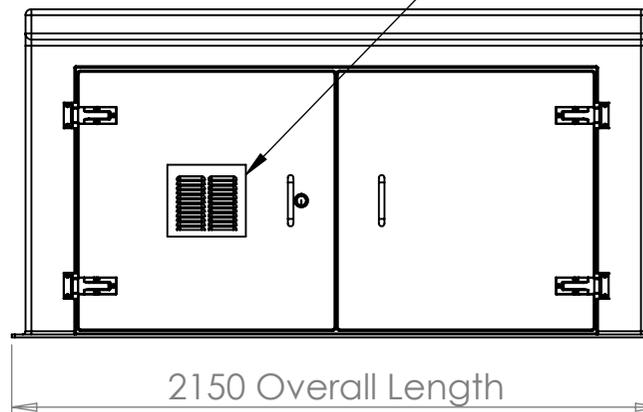


Sloped roof

Double door with Louvered vent

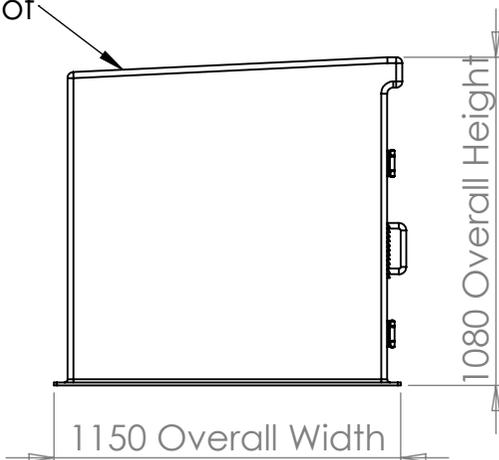

TITLE  
**PWH2000**

DRAWN BY  
J. Ellison

DATE  
17/12/2021

Foundation Requirements:  
The foundation area must be no less in length and width than the external dimensions of the enclosure. The foundation must be constructed so as to be capable of supporting the weight of the enclosure and equipment contained within it. The foundation must be continuous and be no more than ±2mm over any given metre.

DESCRIPTION:  
PWH2000 c/w Louvered vent

DATE	VERSION	NOTES
17/12/2021	A	FIRST ISSUE

TANK SPECIFICATION :	
INTERNAL DIMENSIONS	2000 x 1000 x 1000mm
EXTERNAL DIMENSIONS	2150 x 1150 x 1080mm
NOM. CAPACITY	2000 Litres
DRY WEIGHT	148 KG
INSULATION THICKNESS	25mm
MATERIAL	GRP



CUSTOMER  
CUSTOMER


ALL DIMENSIONS +/- 5mm UNLESS OTHERWISE STATED

A4 ALL DIMENSIONS IN MM - DO NOT SCALE

SCALE:1:25

SHEET 1 OF 2

SCALE:1:25 SHEET 1 OF 2

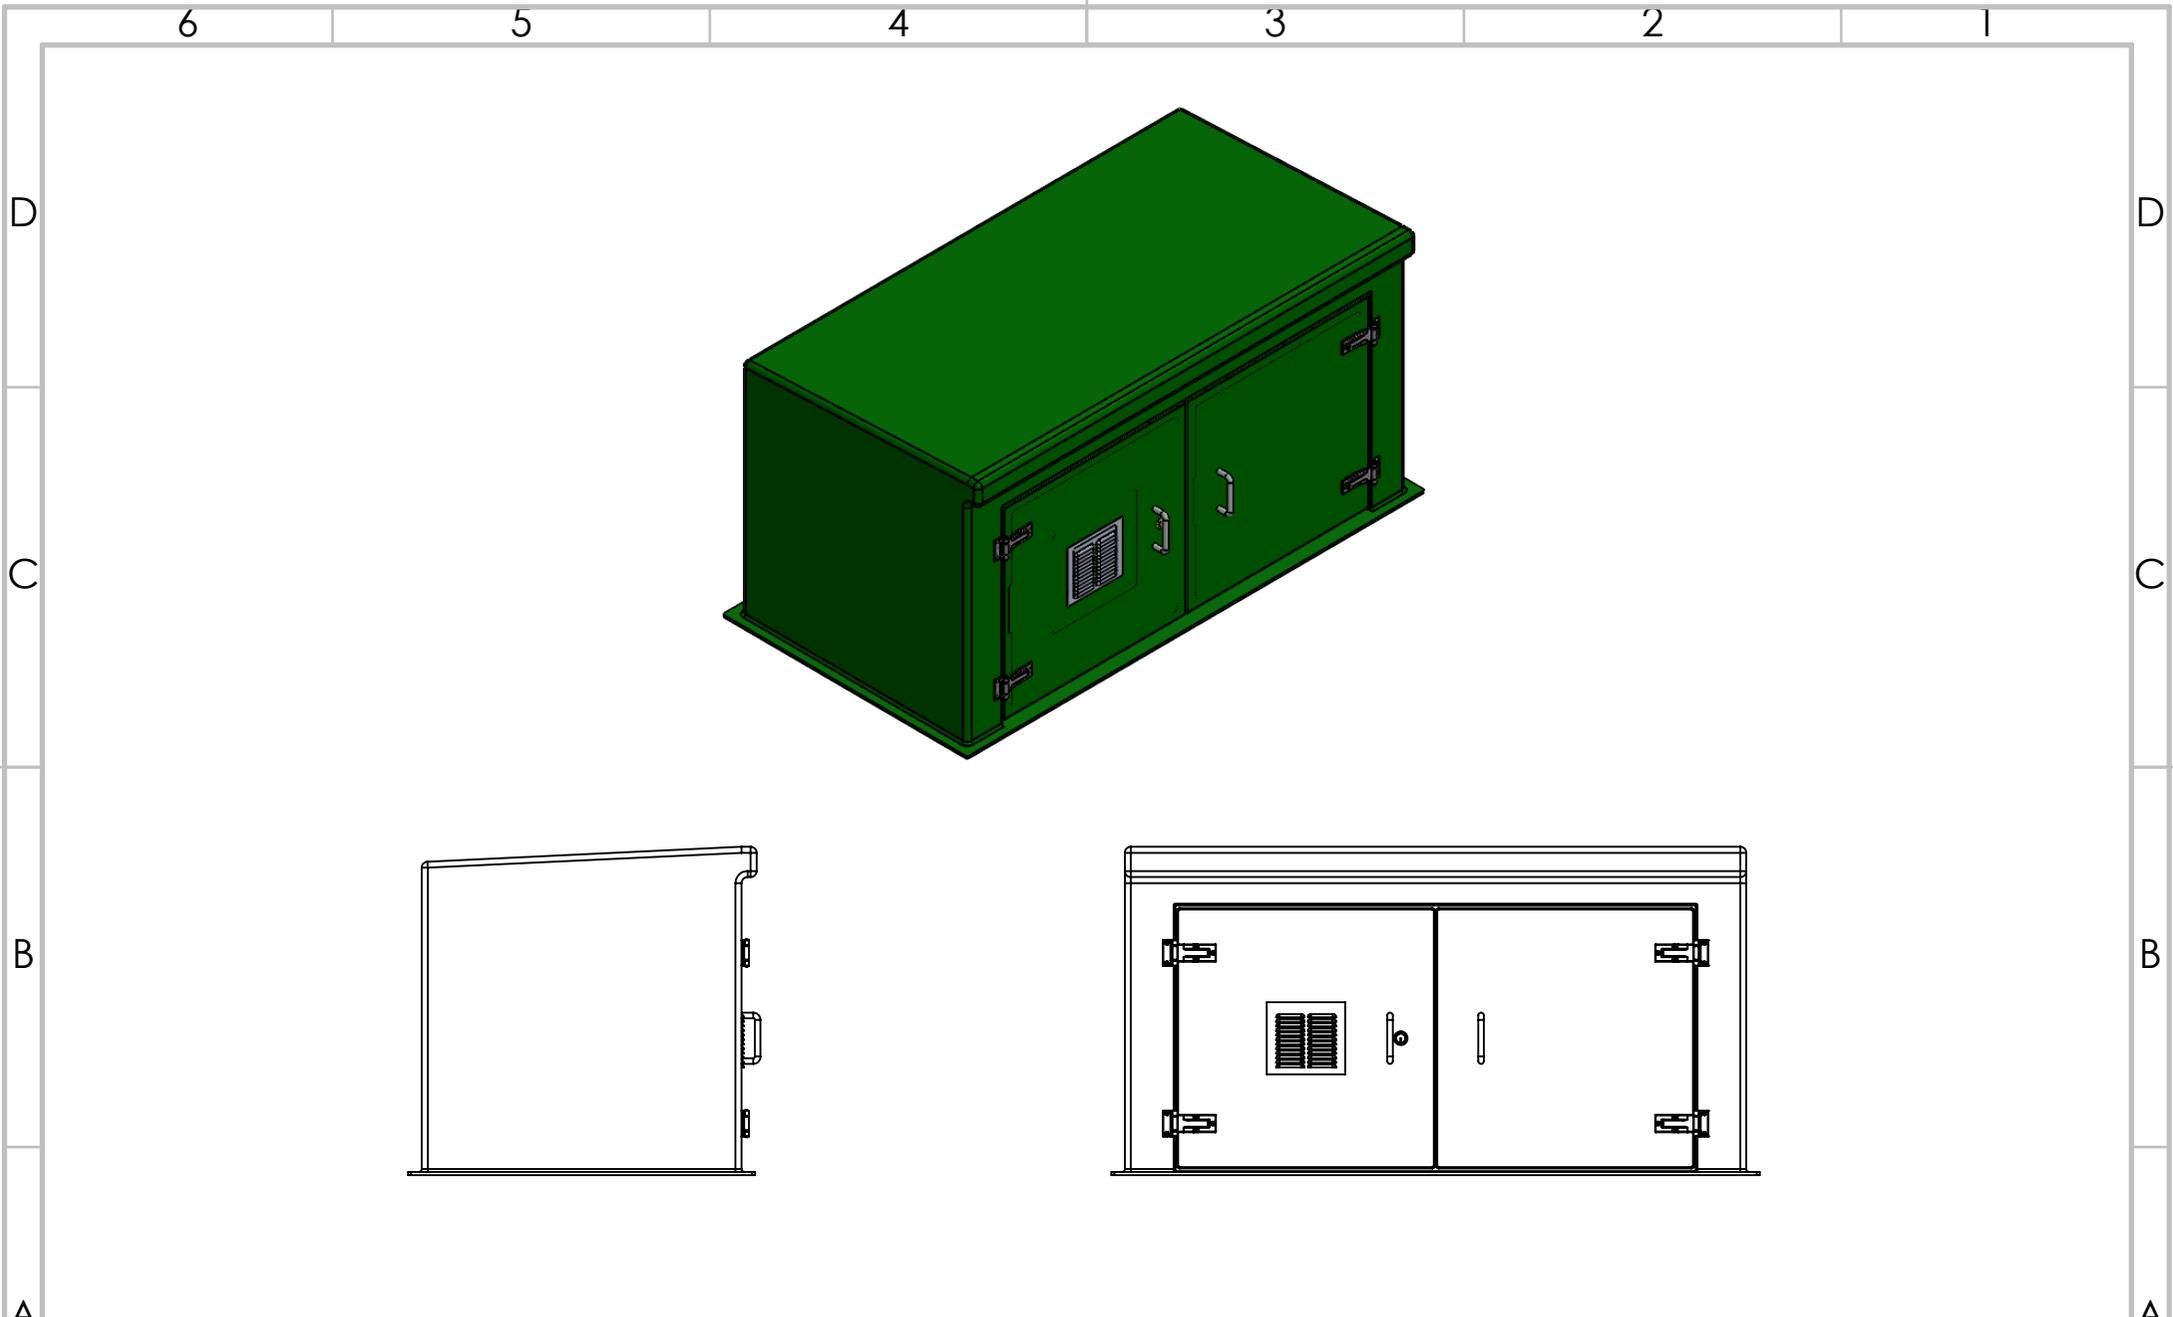

TITLE  
**PWH2000 Green**

DRAWN BY  
**J. Ellison**

DATE  
**17/12/2021**

CUSTOMER  
**CUSTOMER**

Foundation Requirements:  
 The foundation area must be no less in length and width than the external dimensions of the enclosure. The foundation must be constructed so as to be capable of supporting the weight of the enclosure and equipment contained within it. The foundation must be continuous and be no more than ±2mm over any given metre.

ALL DIMENSIONS +/- 5mm  
 UNLESS OTHERWISE STATED

DESCRIPTION:  
**PWH2000 c/w Louvered vent, Green**

**A4**

ALL DIMENSIONS IN MM - DO NOT SCALE

DATE	VERSION	NOTES
17/12/2021	A	FIRST ISSUE

**TANK SPECIFICATION :**

INTERNAL DIMENSIONS	2000 x 1000 x 1000mm
EXTERNAL DIMENSIONS	2150 x 1150 x 1080mm
NOM. CAPACITY	2000 Litres
DRY WEIGHT	148 KG
INSULATION THICKNESS	25mm
MATERIAL	GRP



SCALE:1:25

SHEET 2 OF 2

A

A

B

B

C

C

D

D

6

5

4

3

2

1

6

5

4

3

2

1