

TITLE		PWH2250	
DRAWN BY	J. Ellison	DATE	17/12/2021
CUSTOMER	CUSTOMER		

**Foundation Requirements:**  
 The foundation area must be no less in length and width than the external dimensions of the enclosure. The foundation must be constructed so as to be capable of supporting the weight of the enclosure and equipment contained within it. The foundation must be continuous and be no more than ±2mm over any given metre.

ALL DIMENSIONS +/- 5mm  
 UNLESS OTHERWISE STATED

DESCRIPTION:  
 PWH2250 c/w Louvered vent

A4


ALL DIMENSIONS IN MM DO NOT SCALE

DATE	VERSION	NOTES
17/12/2021	A	FIRST ISSUE

TANK SPECIFICATION :	
INTERNAL DIMENSIONS	1500 x 1000 x 1500mm
EXTERNAL DIMENSIONS	1650 x 1150 x 1580mm
NOM. CAPACITY	2250 Litres
DRY WEIGHT	150 KG
INSULATION THICKNESS	25mm
MATERIAL	GRP



SCALE:1:30    SHEET 1 OF 2

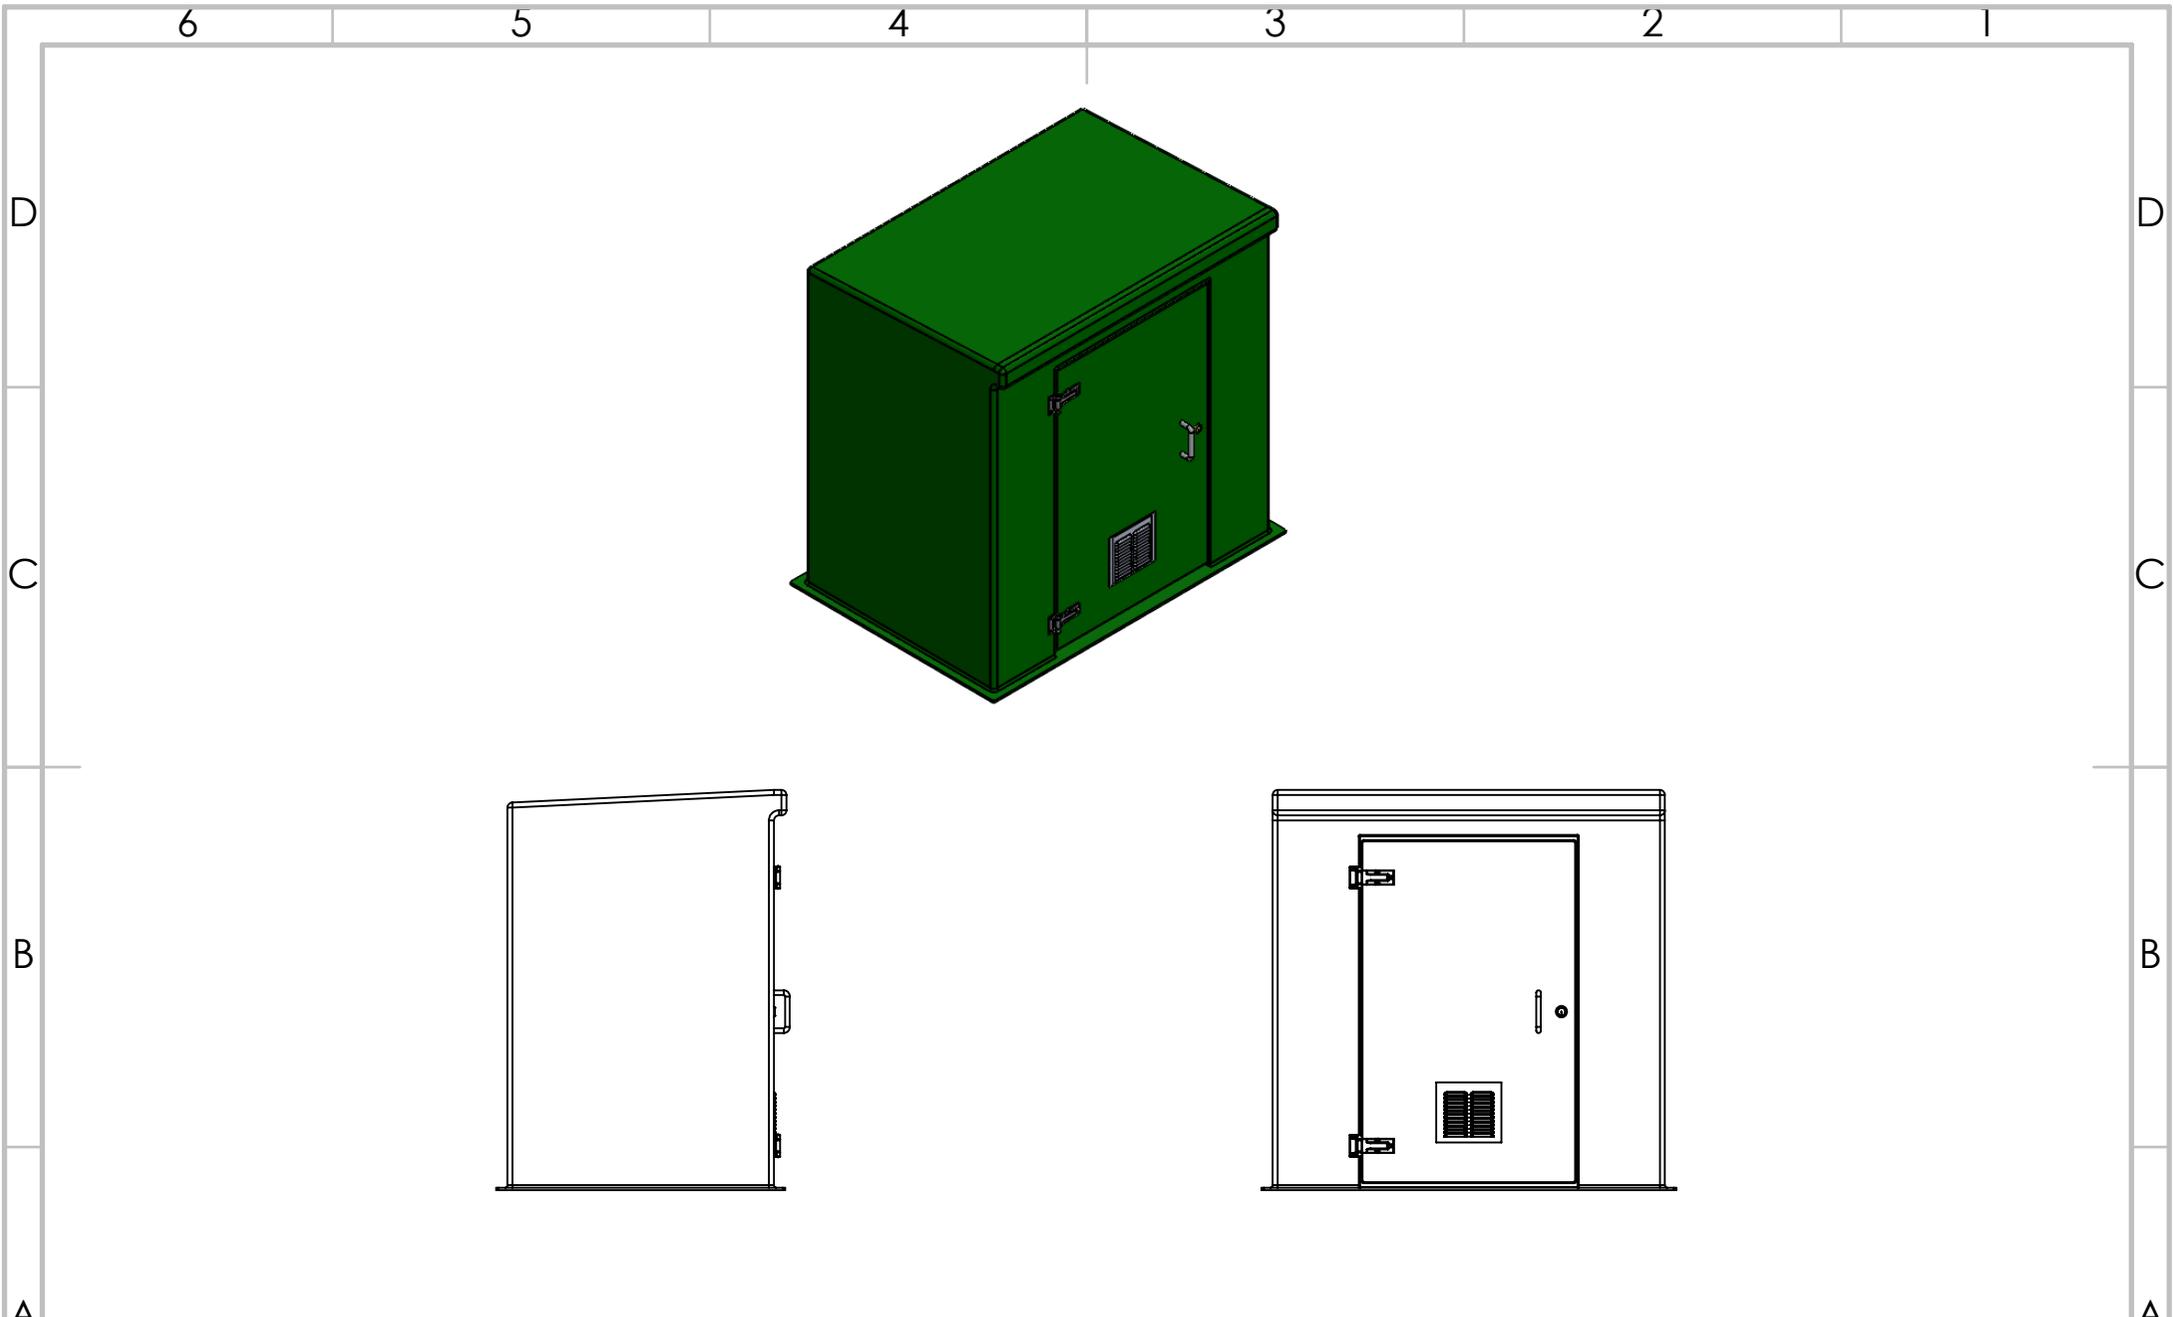

TITLE  
**PWH2250 Green**

DRAWN BY  
**J. Ellison**

DATE  
**17/12/2021**

CUSTOMER  
**CUSTOMER**

Foundation Requirements:  
 The foundation area must be no less in length and width than the external dimensions of the enclosure. The foundation must be constructed so as to be capable of supporting the weight of the enclosure and equipment contained within it. The foundation must be continuous and be no more than ±2mm over any given metre.

ALL DIMENSIONS +/- 5mm  
 UNLESS OTHERWISE STATED

DESCRIPTION:  
**PWH2250 c/w Louvered vent, Green**

ALL DIMENSIONS IN MM    DO NOT SCALE

DATE	VERSION	NOTES
17/12/2021	A	FIRST ISSUE

TANK SPECIFICATION :	
INTERNAL DIMENSIONS	1500 x 1000 x 1500mm
EXTERNAL DIMENSIONS	1650 x 1150 x 1650mm
NOM. CAPACITY	2250 Litres
DRY WEIGHT	150 KG
INSULATION THICKNESS	25mm
MATERIAL	GRP



SCALE:1:30    SHEET 2 OF 2

A

A

B

B

C

C

D

D

6

5

4

3

2

1

6

5

4

3

2

1

A4