

TITLE
CUCOMP.1000-500

DRAWN BY **J. Ellison** DATE **17/06/2022**

CUSTOMER **CUSTOMER**

NOTE:
All tanks must be fully supported on a flat level & continuous foundation providing structural support to the tank when full to maximum operating capacity. It is essential that the user refers to the conditions of installation document prior to the installation of the tank. Under no circumstances should the tank body be used to provide support to pipework and ancillary items. The tank lid is a structural part of the tank and must be in place and fitted correctly when water is contained within the tank.

DESCRIPTION:
CUCOMP.1000-500.AG Air gap combination unit

A4 ALL DIMENSIONS IN MM - DO NOT SCALE


DATE	VERSION	NOTES
28/02/2022	A	FIRST ISSUE

TANK SPECIFICATION :

WET COMPARTMENT	500 x 500 x 1000mm
DRY COMPARTMENT	500 x 500 x 1000mm
EXTERNAL DIMENSIONS	1170 x 1170 x 1107mm
NOMINAL CAPACITY	500 Litres
INSULATION THICKNESS	25mm
MATERIAL	GRP



SCALE:1:20 SHEET 1 OF 2

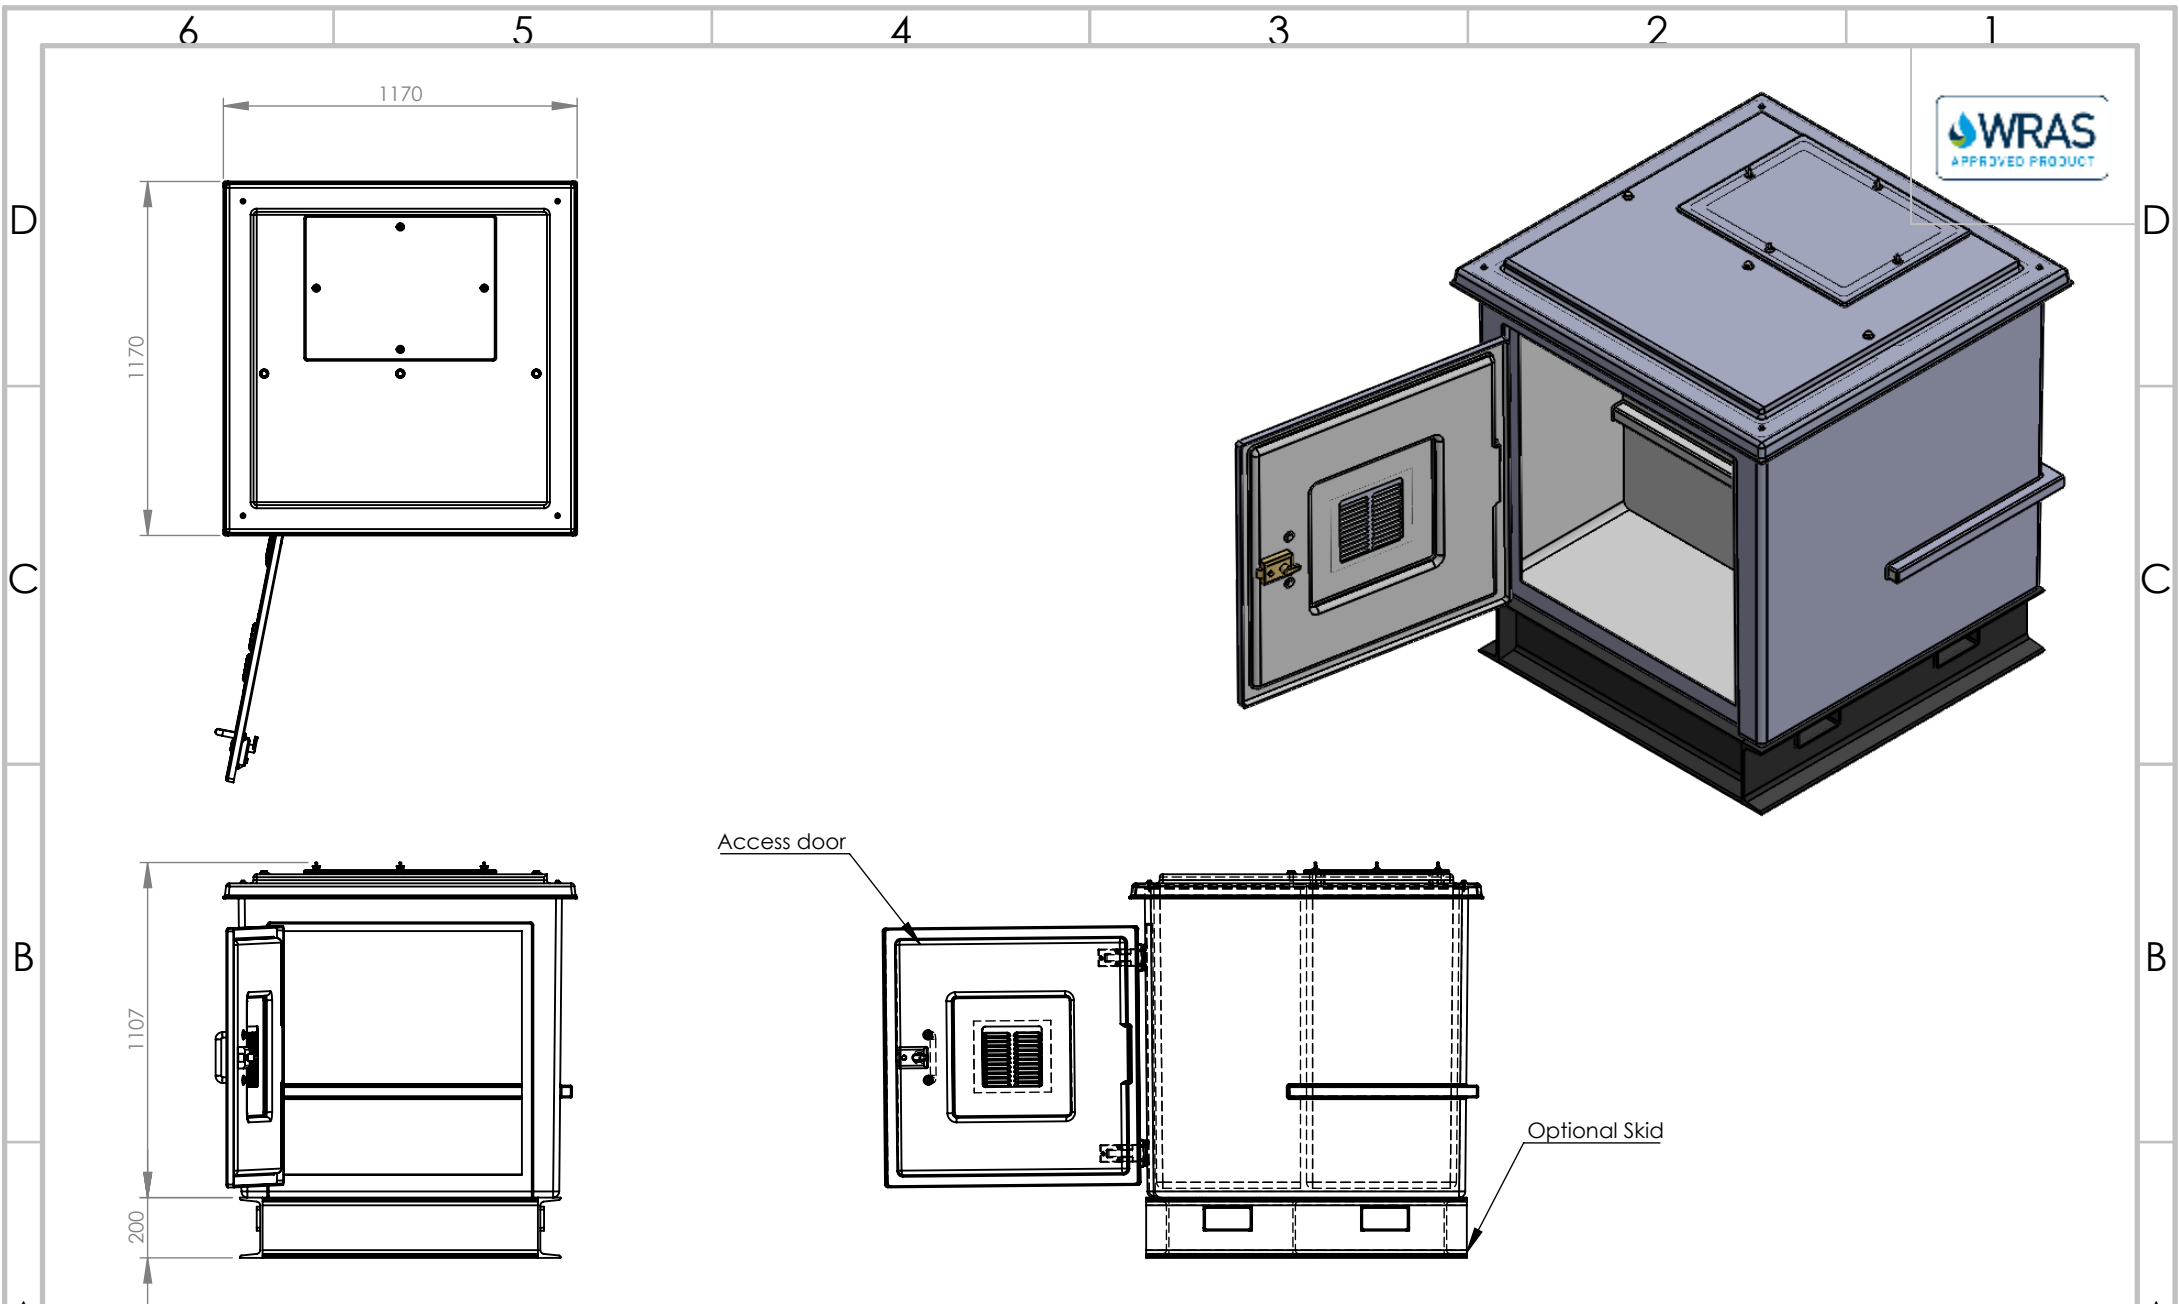

TITLE
CUCOMP.1000-500
c/w skid

DRAWN BY
J. Ellison

DATE
17/06/2022

CUSTOMER
CUSTOMER

NOTE:
 All tanks must be fully supported on a flat level & continuous foundation providing structural support to the tank when full to maximum operating capacity. It is essential that the user refers to the conditions of installation document prior to the installation of the tank. Under no circumstances should the tank body be used to provide support to pipework and ancillary items. The tank lid is a structural part of the tank and must be in place and fitted correctly when water is contained within the tank.

ALL DIMENSIONS +/- 5mm
 UNLESS OTHERWISE STATED

DESCRIPTION:
CUCOMP.1000-500.AG Air gap combination unit
c/w steel skid

A4

ALL DIMENSIONS IN MM - DO NOT SCALE

DATE	VERSION	NOTES
28/02/2022	A	FIRST ISSUE

TANK SPECIFICATION :	
WET COMPARTMENT	500 x 1000 x 1000mm
DRY COMPARTMENT	500 x 1000 x 1000mm
EXTERNAL DIMENSIONS	1170 x 1170 x 1307mm
NOMINAL CAPACITY	500 Litres
INSULATION THICKNESS	25mm
MATERIAL	GRP

TANKS DIRECT

SCALE:1:25

SHEET 2 OF 2