


Fabrication Specifications				
ITEM	INDEX	DEPTH (mm)	DIA. (mm)	CLOCKFACE POSITION
Tank depth	A	1000	-	
Tank Ø	B	-	1000	
Inlet	C1		110	
Inlet	C2			
Inlet	C3			
Discharge	D		63	12
Cable duct			110	
Vent			110	

**PLEASE NOTE THAT THIS DOCUMENT MUST BE READ IN CONJUNCTION WITH THE INSTALLATION & OPERATING GUIDELINES**

**Comments**

Please Note - Inlet invert should be between 400 - 515 mm.

Inlet seals and ducts can be supplied loose to be drilled and fitted on site

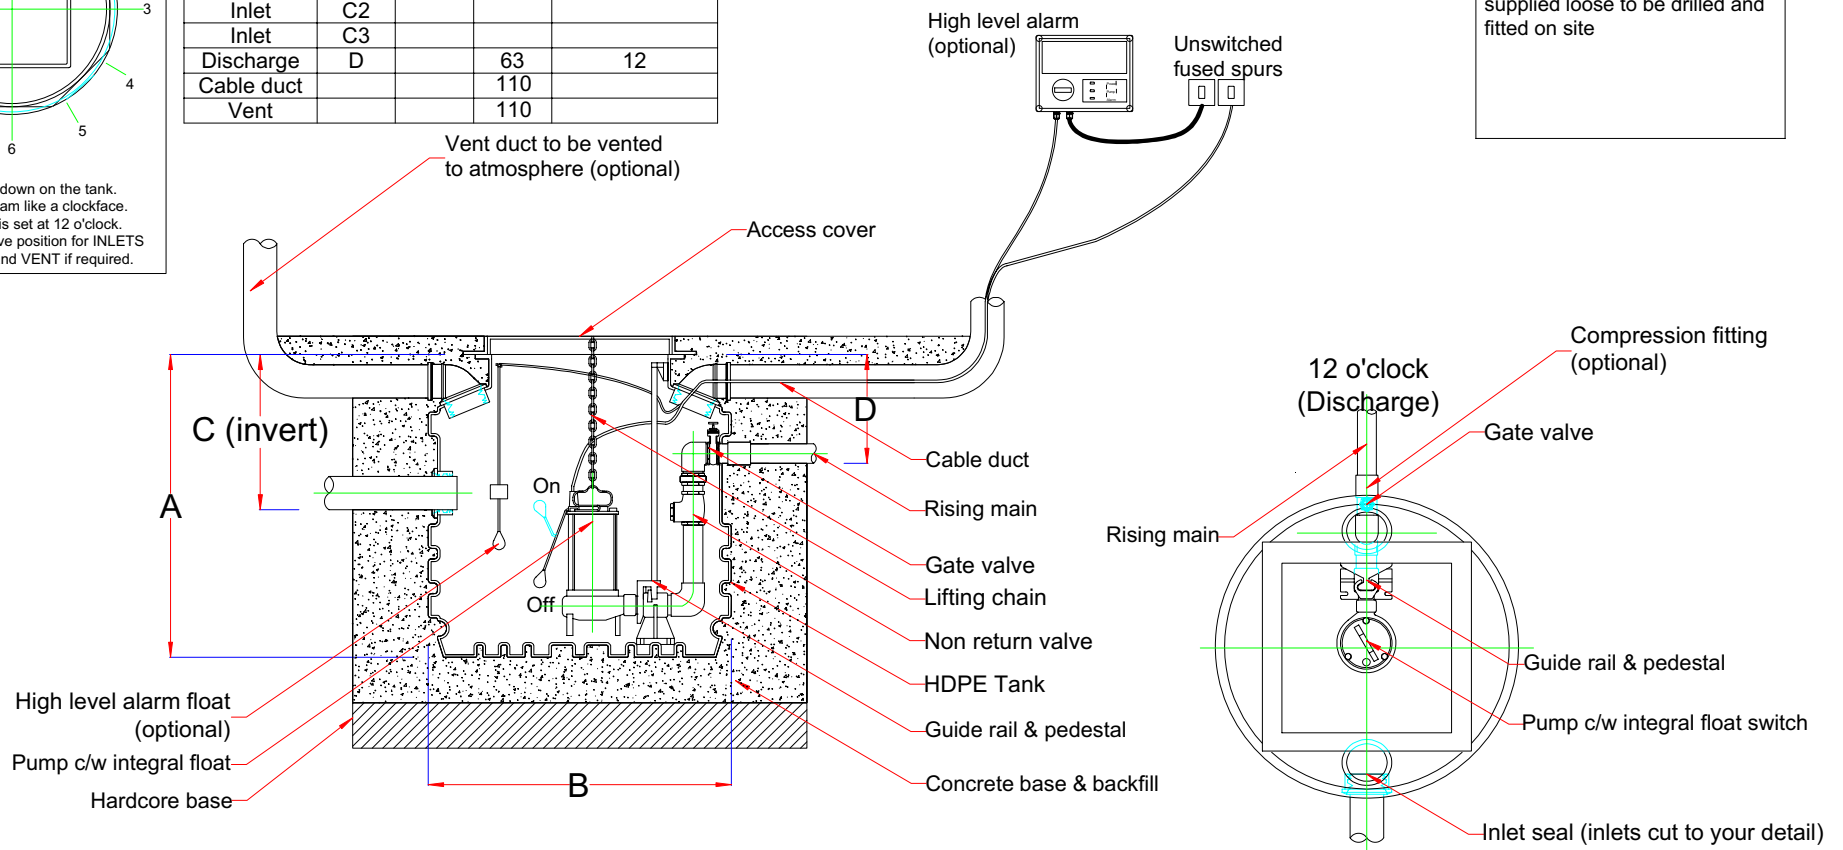

REV	DETAIL	DATE	DRAWN

Tanks Direct Ltd  
Channel House, Mart Road, Minehead, Somerset, TA24 5BJ  
T: 01643 703358 F: 03332 223858  
sales@tanks-direct.co.uk www.tanks-direct.co.uk

TITLE  
Single rigged Ø1000 x 1000 mm typical layout

CUSTOMER

DRAWING NO	DATE	DRAWN
111128	09/11/2018	gf
THIRD ANGLE PROJECTION		SCALE
		NOT TO SCALE
TOLERANCE +/- 2%		SHEET
		1 of 1
REV		0